MANUFACTURER DOCUMENT PACKAGE

Manufacturer's Manual

Reference package for procurement and maintenance review

HONEYWELL

8C-PCNT02 51454363-275

SERIES 8 C300 CONTROLLER MODULE

Used with the applicable Experion Series 8 C300 configuration.

REFERENCE PACKAGE

OFFICIAL DOCUMENT

Selected official manufacturer pages follow this cover.

Source: Honeywell technical documentation for 8C-PCNT02 51454363-275

1. Introduction

1.1. Overview

This document provides technical information to configure the Experion® Series 8 I/O and the C300 Controller.

1.2. Scope

The following Series 8 hardware items are included in this document.

- Series 8 C300 Controller
- Analog Input with HART – Differential
- Analog Input with HART – Single Ended
- Analog Input – Single Ended
- Low Level Analog (Temperature) Input LLAI
- Analog Output with HART
- Analog Output
- Digital Input, 24 VDC
- Digital Input Sequence of Events (SOE)
- Digital Input Pulse Accumulation
- Digital Output, 24 VDC
- DO Relay Extension Board

1.3. Definitions

- **Input Output Termination Assembly (IOTA):** An assembly that holds the IOM and the connections for field wiring,
- **Input Output Module (IOM):** A device that contains most of the electronics required to perform a specific I/O function. The IOM plugs onto the IOTA.

2. Platform Environmental Specifications

2.1. General Environmental Characteristics

This section relates to the physical characteristics applicable to Series 8 C300 controller and all Series 8 I/O components. Where applicable, specifications state limits within an approved cabinet and to the cabinet skin.

Consideration	Operating Limit [1]	Transportation and Storage Limits [1a]
Ambient Temp Range	External: 0 to 50°C [2] Internal : 0 to 60°C [3]	-40 to 85°C
Temp. Rate of Change	<= 1°C/min	<=5°C/min
Relative Humidity [3]	5 to 95% (non-condensing) [4]	5 to 95% (non-condensing) [4]
Barometric Pressure Altitude	-300 to +3000 m	Any
Corrosives	G3 Standard (ISA S71.04) - Denoted by “8C-“ model number in this doc	G3 Standard (ISA S71.04) - Denoted by “8C-“ model number in this doc
Vibration (3 axes)	Sinusoidal (5 to 10 Hz) 2.54mm/0.100in Max (10 to 150 Hz) 0.5 g max. (0-Pk)	Random Vertical Shipping Axis 5 to 300 Hz 1.07 g (rms) Longitudinal and Transverse 10 to 500 Hz, 0.74 g (rms) 60 Minutes each axis
Mechanical Shock (3 Axes)	Site Induced: Terminal Peak Sawtooth waveform 4g max. @25ms	N/A

Note 1 – Operating Limits define the range of operating conditions within which the system is designed to operate. Performance characteristics are defined when operating in this state. Please see ANSA/ISA D 51.1 Process Instrumentation Terminology for more information.

Note 1a – Transportation and Storage Limits define the range of conditions to which the system may be subjected without permanent damage to the equipment. Performance is not guaranteed in this state. Please see ANSA/ISA D 51.1 Process Instrumentation Terminology for more information.

Note 2 – This rating applies to the external ambient temperature of the Standard 2000mm enclosure with doors closed.

Note 3 – This rating applies to the internal ambient temperature of the Standard 2000mm enclosure with the doors closed. New version of the C300 controller(8C-PCNT05) and Memory Backup Assembly module (50182539-001) support an extended temperature range from 0°C to 70°C.

Note 4 – The maximum relative humidity spec applies up to 40°C. Above 40°C the RH spec is de-rated to 55% to maintain constant moisture content.

A note on the transportation of Batteries:

Some Government agencies have regulations that may prohibit air transport of Lithium Batteries.

3. C300 Controller

3.1. Overview

The Experion Series 8 C300 controller forms the heart of the Experion control system and deterministically executes control strategies, batch operations, interfaces to local and remote I/O and directly hosts custom programmable applications. The compact controller design does not require any additional Interface / communication modules and all control execution and communications are contained in the controller module.

The C300 controller runs the filed proven, deterministic Control Execution Environment (CEE) which is the core C300 software that provides powerful and robust control for the distributed control system (DCS). The control strategies are configured and loaded to the C300 controller through the Control Builder, an easy and intuitive engineering tool.

The C300 Controller is constructed using the Series 8 form factor that employs an Input Output Termination Assembly (IOTA) and an electronics module which mounts and connects to the IOTA. One C300 Controller module and its IOTA contains all of the control and communication functionalities. The C300 IOTA contains only passive devices such as FTE address switches, FTE cable connectors and I/O Link cable connectors. Figure 1 below depicts the IOTA components.

The C300 Controller may operate in both non-redundant and redundant configurations. Redundant operation require a second identical controller with its own IOTA and connecting redundancy cable. The C300 Controller supports Series 8 I/O modules. Two IO Link interfaces, which are redundant, provide connection between the C300 controller and associated I/O modules. The IO Link interface connectors are on the C300 IOTA.

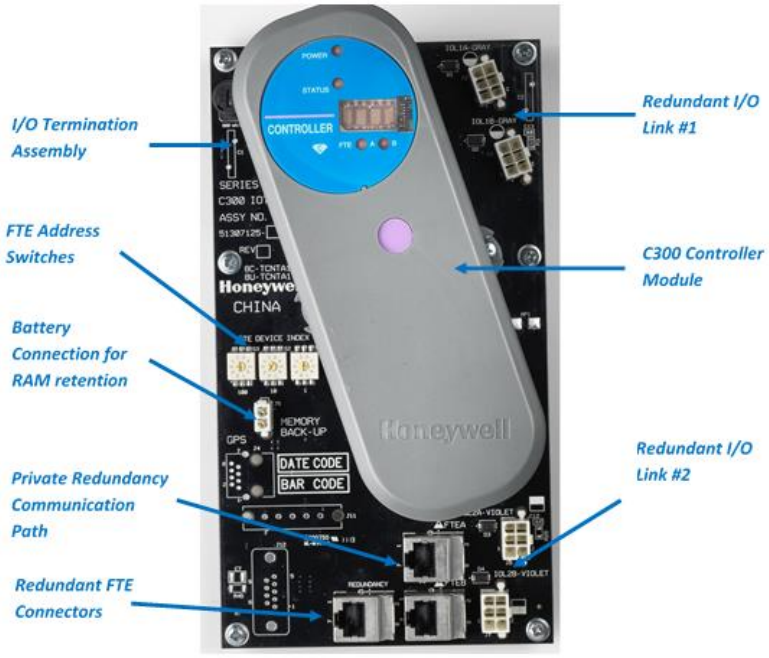


Figure 1 - C300 Controller

3.2. Model Numbers

The Model Numbers of C300 controller are shown as below:

Model Number	Description
8C-PCNT03	Series 8 C300 Controller, Coated [1,3,4]
8C-PCNT05	Series 8 C300 Controller, V5, Coated [5,6]
8C-TCNTA1	Series 8 C300 Controller I/O Termination Assembly(IOTA), Coated [1]
51305980-836	Cable, Redundant C300 Controller [2]

Note 1 – Conformal coating applied on the module and the IOTA

Note 2 – Redundancy is implemented with two modules/IOTAs and a redundancy cable (51305980-836)

Note 3 – Optional rechargeable battery pack for C300 Memory Backup is available, details are provided in section 5.4

Note 4 – 8C-PCNT02 part number is replaced by 8C-PCNT03. The new controller (8C-PCNT03) is compatible with all current and previous PC/LX releases.

Note 5 – 8C-PCNT05 is the new S8 C300 controller, and only supports Experion R520 and later releases. Both 8C-PCNT03 and 8C-PCNT05 supports Experion R520 releases. While 8C-PCNT03 also supports all previous Experion releases. 8C-PCNT05 is not interoperable with 8C-PCNT03 controller.

Note 5 – 8C-PCNT05 uses the same S8 C300 IOTA, i.e. 8C-TCNTA1 and controller redundancy cable.

3.3. C300 Controller Specifications

3.3.1. C300 Control Execution Environment (CEE)

The C300 CEE provides an execution and scheduling environment in which Control Modules (CMs) and Sequential Control Modules (SCMs) execute user-configured control strategies. The CEE also support peer to peer communications with other C300 controllers and communication modules like Foundation Fieldbus and Profibus. The C300 CEE is configured using the Control Builder Engineering environment. The Control builder provides a graphical engineering environment where engineers can configure the Experion system and create control strategies by using the various function blocks available in the Library. The C300 CEE based control strategies can be configured with minimum execution rates of 50 msec.

3.3.2. C300 Hardware Specifications

Specifications	8C-PCNT03	8C-PCNT05
Power requirement	24 V (provided through cables by the Series 8 power system)	
IOTA Dimension	220 mm (9 “) height, 120 mm (4,75 “) width	
Program Memory	16MB	32MB
Processor core	Single	Dual
Supported Releases	Experion R110, 120, R500, R51x and R520	Experion R520 and onwards