

OFFICIAL DOCUMENT PACKAGE

Manufacturer's Manual

Amikon cover with selected official ABB technical pages

ABB AC500 / S500-eCo I/O

DI562

AC DC INPUT MODULE

Selected official pages retain the original technical tables, ratings, notes and pagination.

OFFICIAL SOURCE

ABB 3ADR010049 rev.12, 2024-11-15, DI562 datasheet


DI562 ordering, input specifications and applicable system requirements, original pages 1-7

This technical extract does not replace the complete equipment and system manuals. Check the installed hardware and project before use.

DATA SHEET

DI562

Digital input module

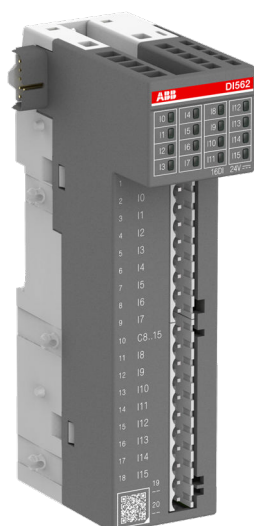


1 Ordering data

Part no.	Description	Product life cycle phase *)
1TNE 968 902 R2102	DI562, digital input module, 16 DI, 24 V DC / 24 V AC	Active
1TNE 968 901 R3101	Terminal block TA563-9, 9 pins, screw front, cable side, 6 pieces per unit	Active
1TNE 968 901 R3102	Terminal block TA563-11, 11 pins, screw front, cable side, 6 pieces per unit	Active
1TNE 968 901 R3103	Terminal block TA564-9, 9 pins, screw front, cable front, 6 pieces per unit	Active
1TNE 968 901 R3104	Terminal block TA564-11, 11 pins, screw front, cable front, 6 pieces per unit	Active
1TNE 968 901 R3105	Terminal block TA565-9, 9 pins, spring front, cable front, 6 pieces per unit	Active
1TNE 968 901 R3106	Terminal block TA565-11, 11 pins, spring front, cable front, 6 pieces per unit	Active



*) Modules in lifecycle Classic are available from stock but not recommended for planning and commissioning of new installations.

2 Dimensions

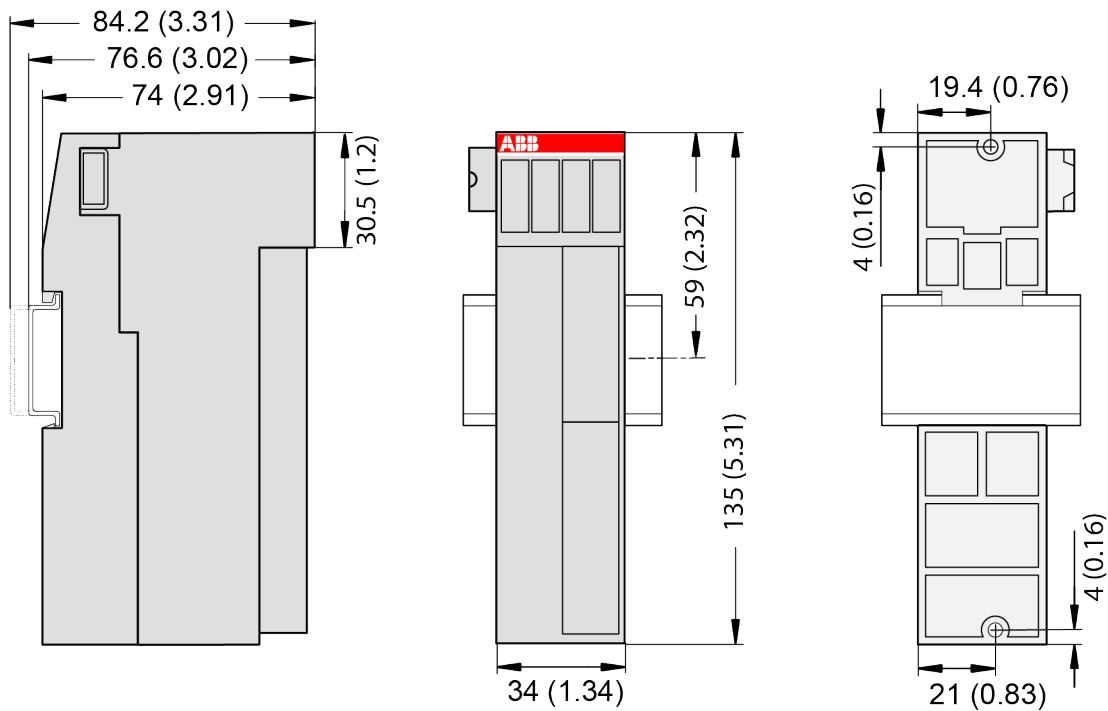

The dimensions are in mm and in brackets in inch.

3 Technical data

3.1 Technical data of the module

The system data of AC500-eCo apply.

↪ Chapter 4 “System data AC500-eCo” on page 4

Only additional details are therefore documented below.

Parameter	Value
Galvanic isolation	Yes, between the input groups and the rest of the module
Isolated groups	2 (8 channels per group)
Current consumption from 24 V DC power supply at the L+/UP and M/ZP terminals of the CPU/communication interface module	Ca. 5 mA
Max. power dissipation within the module	3.2 W
Weight	Ca. 115 g
Mounting position	Horizontal or vertical
Cooling	The natural convection cooling must not be hindered by cable ducts or other parts in the control cabinet.

3.2 Technical data of the digital inputs

Parameter		Value		
Number of channels per module		16 inputs (24 V DC / 24 V AC)		
Distribution of the channels into groups		2 (8 channels per group)		
Connections of the channels I0 to I7		Terminals 2 ... 9		
Connections of the channels I8 to I15		Terminals 11 ... 18		
Reference potential for the channels I0 to I7		Terminal 1 (positive or negative pole of the process supply voltage, signal name I0 ... I7)		
Reference potential for the channels I8 to I15		Terminal 10 (positive or negative pole of the process supply voltage, signal name I8 ... I15)		
Indication of the input signals		1 yellow LED per channel; the LED is ON when the input signal is high (signal 1). The module is powered through the I/O bus.		
Monitoring point of input indicator		LED is part of the input circuitry		
Input type according to EN 61131-2		Type 1 source	Type 1 sink	Type 1 AC ¹⁾
Input signal range		-24 V DC	+24 V DC	24 V AC 50/60 Hz
	Signal 0	-5 V ... +3 V	-3 V ... +5 V	0 V AC ... 5 V AC
	Undefined signal	-15 V ... -5 V	+5 V ... +15 V	5 V AC ... 14 V AC
	Signal 1	-30 V ... -15 V	+15 V ... +30 V	14 V AC ... 27 V AC
Input current per channel				
	Input voltage 24 V	Typ. 5 mA		Typ. 5 mA r.m.s.
	Input voltage 5 V	Typ. 1 mA		Typ. 1 mA r.m.s.
	Input voltage 14 V			Typ. 2.7 mA r.m.s.
	Input voltage 15 V	> 2.5 mA		
	Input voltage 27 V			Typ. 5.5 mA r.m.s.
	Input voltage 30 V	< 8 mA		
Max. permissible leakage current (at 2-wire proximity switches)		1 mA		Typ. 1 mA r.m.s.
Input delay (0->1 or 1->0)		Typ. 8 ms		
Input data length		2 bytes		
Max. cable length				
	Shielded	500 m		
	Unshielded	300 m		

¹⁾For version before E0, when inputs are used with 24 V AC, external surge limiting filters are required.

4 System data AC500-eCo

4.1 Environmental conditions

Table 1: Process and supply voltages

Parameter		Value
24 V DC		
	Voltage	24 V (-15 %, +20 %)
	Protection against reverse polarity	Yes
24 V AC		
	Voltage	24 V (-15 %, +10 %)
	Frequency	50/60 Hz (-6 %, +4 %)
100 V AC ... 240 V AC wide-range supply		
	Voltage	100 V ... 240 V (-15 %, +10 %)
	Frequency	50/60 Hz (-6 %, +4 %)
Allowed interruptions of power supply, according to EN 61131-2		
	DC supply	Interruption < 10 ms, time between 2 interruptions > 1 s, PS2
	AC supply	Interruption < 0.5 periods, time between 2 interruptions > 1 s



NOTICE!

Risk of damaging the PLC due to improper voltage levels!

- Never exceed the maximum tolerance values for process and supply voltages.
 - Never fall below the minimum tolerance values for process and supply voltages.
- Observe the **system data** and the **technical data** of the used module.



NOTICE!

Improper voltage level or frequency range which cause damage of AC inputs:

- AC voltage above 264 V
- Frequency below 47 Hz or above 62.4 Hz



NOTICE!

Improper connection leads cause overtemperature on terminals.

PLC modules may be destroyed by using wrong cable type, wire size and cable temperature classification.

Parameter		Value
Temperature		
	Operating	0 °C ... +60 °C (horizontal mounting of modules) 0 °C ... +40 °C (vertical mounting of modules and output load reduced to 50 % per group)
	Storage	-40 °C ... +70 °C
	Transport	-40 °C ... +70 °C

Parameter		Value
Humidity		Max. 95 %, without condensation
Air pressure		
	Operating	> 800 hPa / < 2000 m
	Storage	> 660 hPa / < 3500 m

4.2 Creepage distances and clearances

The creepage distances and clearances meet the requirements of the overvoltage category II, pollution degree 2.

4.3 Power supply units



AC500 and AC500-eCo PLC devices are Class II/Class III devices and do not require a Protective Earth (PE) connection.

For proper EMC performance, all metal parts, DIN rails, mounting screws, and cable shield connection terminals are connected to a common ground and provide Functional Earth (FE). This is typically connected to a common reference potential, such as equipotential bonding rails.

Signal Grounds (SGND or GND) are used for signal reference and must not be connected to cable shields, FE or other signals unless otherwise specified in the specific device description.

For the supply of the modules, power supply units according to SELV or PELV specifications must be used.



Safety Extra Low Voltage (SELV) and Protective Extra Low Voltage (PELV)

To ensure electrical safety of AC500/AC500-eCo extra low voltage circuits, 24 V DC supply, communication interfaces, I/O circuits, and all connected devices must be powered from sources meeting requirements of SELV, PELV, class 2, limited voltage or limited power according to applicable standards.



WARNING!

Improper installation can lead to death by touching hazardous voltages!

To avoid personal injury, safe separation, double or reinforced insulation and separation of the primary and secondary circuit must be observed and implemented during installation.

- Only use power converters for safety extra-low voltages (SELV) with safe galvanic separation of the primary and secondary circuit.
- Safe separation means that the primary circuit of mains transformers must be separated from the secondary circuit by double or reinforced insulation. The protective extra-low voltage (PELV) offers protection against electric shock.

4.4 Electromagnetic compatibility

Table 2: Range of use

Application
Device suitable only as <i>Control Equipment for Industrial Applications</i> .

Table 3: Electromagnetic compatibility

Parameter	Value
Device suitable only as <i>Control Equipment for Industrial Applications</i> , including marine applications. IEC 61131-2, zone B 🔗 Chapter 4.6 “Approvals and certifications” on page 7	
Radiated emission according to IEC 61000-6-4 CISPR11, class A	Yes
Conducted emission according to IEC 61000-6-4 CISPR11, class A	Yes
Electrostatic discharge (ESD) according to IEC 61000-4-2, criterion B	Air discharge: 8 kV Contact discharge: 6 kV
Fast transient interference voltages (burst) according to IEC 61000-4-4, criterion B	Power supply (DC): 2 kV Digital inputs/outputs (24 V DC): 1 kV Digital inputs/outputs (240 V AC): 2 kV Analog inputs/outputs: 1 kV Communication lines shielded: 1 kV
High energy transient interference voltages (surge) according to IEC 61000-4-5, criterion B	Power supply (DC): - Line to ground: 1 kV - Line to line: 0,5 kV Digital inputs/outputs/relay: (24 V DC): - Line to ground: 1 kV (AC): - Line to ground: 2 kV - Line to line: 1 kV Analog inputs/outputs: - Line to ground: 1 kV Communication lines: - Line to ground: 1 kV
Influence of radiated disturbances IEC 61000-4-3, criterion A	Test field strength: 10 V/m
Influence of line-conducted interferences IEC 61000-4-6, criterion A	Test voltage: 10 V
Power frequency magnetic fields IEC 61000-4-8, criterion A	30 A/m 50 Hz 30 A/m 60 Hz

4.5 Mechanical data

Parameter	Value
Mounting	Horizontal/Vertical
Wiring method	Spring/screw terminals
Degree of protection	PLC system: IP 20 • with all modules or option boards plugged in • with all terminals plugged in • with all covers closed
Housing	Classification V-0 according to UL 94
Vibration resistance (sinusoidal) acc. to IEC 60068-2-6	All three axes 2 Hz ... 8.4 Hz, 3.5 mm peak, 8.4 Hz ... 150 Hz, 1 g
Shock test acc. to IEC 60068-2-27	All three axes 15 g, 11 ms, half-sinusoidal
Mounting of the modules:	
Mounting Rail Top Hat according to IEC 60715	35 mm, depth 7.5 mm or 15 mm
Mounting with screws	M4
Fastening torque	1.2 Nm

4.6 Approvals and certifications

The PLC Automation catalog contains an [*overview of the available approvals and certifications*](#).