

MANUFACTURER DOCUMENT PACKAGE

Manufacturer's Manual

Selected official pages for procurement and maintenance review

PRODUCT BRAND

Bently Nevada

PRODUCT MODEL

3500/92

3500/92 - Machinery monitoring communication gateway
Selected manufacturer pages; verify exact configuration.

OFFICIAL SOURCE

Datasheet 141542 Rev. M

[Open current manufacturer source](#)

AMIKON PRODUCT SUPPORT

+86-18020776786 INFO@AMIKON.CN

[AMIKONG.COM](https://www.amikong.com)

Amikon Limited prepared this independent reference package. Selected manufacturer pages follow with their original content and pagination visible.

3500/92 Communication Gateway

Datasheet

Bently Nevada Machinery Condition Monitoring

141542 Rev. M



Description

The 3500/92 Communication Gateway module provides extensive communication capabilities of all rack monitored values and statuses for integration with process control and other automation systems using both Ethernet TCP/IP and serial (RS232/RS422/RS485) communications capabilities. It also permits Ethernet communications with 3500 Rack Configuration Software and Data Acquisition Software.

Supported protocols include:

- Modicon Modbus protocol (via serial communications)
- Modbus/TCP protocol (a variant of serial Modbus used for TCP/IP Ethernet communications)
- Proprietary Bently Nevada protocol (for communication with 3500 Rack Configuration and Data Acquisition Software packages)



The Ethernet connection to the 3500/92 is an RJ45 connection for 10BASE-T star configuration Ethernet networks.

The 3500/92 supports the communication interfaces, communication protocols, and other features from the original 3500/90 with the exception of the primary value Modbus registers. The 3500/92 now has a Configurable Modbus Register Utility, which can provide the same functionality originally addressed by the primary value Modbus registers.



Specifications

Inputs

Power Consumption	5.0 Watts typical with ModbusRS232/ RS422 I/O Module 5.6 Watts typical with Modbus RS485 I/O Module
Data Types	Collects data from other modules in the rack, such as current measured values with time stamp, module statuses, and current alarm statuses, via a high speed internal network. Exact data types returned depend on module type and channel configuration. Update Time: The data collection rate depends on rack configuration but will not exceed 1 second for all modules in the 3500 rack.

Outputs

OK LED	Indicates when the 3500/92 is operating properly.
TX/RX LED	Indicates when the 3500/92 is communicating with other modules in the 3500 rack.

Protocols

BNC Host Protocol	Communication with 3500 Configuration Software and 3500 Data Acquisition and Display Software over Ethernet TCP/IP.
Modbus	Based on AEG Modicon PI-MBUS-300 Reference Manual. Uses Remote Terminal Unit (RTU) transmission mode.
Ethernet	
Communication Link	Ethernet, 10Mbps, and conforms to IEEE802.3
Protocol	Ethernet TCP/IP frame and Modbus/TCP
Connection	RJ-45 (telephone jack style) for 10BASE-T Ethernet cabling

Environmental Limits

Main and I/O Module	
Operating Temperature	-30°C to +65°C (-22°F to +149°F)
Storage Temperature	-40°C to +85°C (-40°F to +185°F)
Humidity	95%, non-condensing

Physical

Main Board

Dimensions (Height x Width x Depth)	241 mm x 24.4 mm x 242 mm (9.50 in x 0.96 in x 9.52 in)
Weight	0.82 kg (1.8 lb.)

I/O Modules

Dimensions (Height x Width x Depth)	241 mm x 24.4 mm x 99.1 mm (9.50 in x 0.96 in x 3.90 in)
Weight	0.44 kg (0.96 lb.)

Rack Space Requirements

Monitor Module	1 full-height front slot
I/O Modules	1 full-height rear slot

Compliance and Certifications

FCC

This device complies with part 15 of the FCC Rules. Operation is subject to the following two conditions:

- This device may not cause harmful interference.
- This device must accept any interference received, including interference that may cause undesired operation.

EMC

European Community Directive:

EMC Directive 2014/30/EU

Standards:

EN 61000-6-2; Immunity for
Industrial Environments
EN 61000-6-4; Emissions for
Industrial Environments

Electrical Safety

European Community Directive:

LV Directive 2014/35/EU

Standards:

EN 61010-1

RoHS

European Community Directive:

RoHS Directive 2011/65/EU

Maritime

DNV GL rules for classification – Ships,
offshore units, and high speed and light
craft

ABS Rules for Condition of Classification,
Part 1

- Steel Vessels Rules
- Offshore Units and Structures

Hazardous Area Approvals



For the detailed listing of country and product-specific approvals, refer to the [Approvals Quick Reference Guide \(108M1756\)](#).


For additional technical documentation, please log in to bntechsupport.com and access the Bently Nevada Media Library.

cNRTLus

Class I, Zone 2: AEx/Ex nA nC ic IIC T4 Gc;
Class I, Zone 2: AEx/Ex ec nC ic IIC T4 Gc;
Class I, Division 2, Groups A, B, C, and D;

T4 @ Ta= -20°C to +65°C (-4°F to +149°F)
When installed per drawing 149243 or
149244.

ATEX/IECEx



Ex nA nC ic IIC T4 Gc
Ex ec nC ic IIC T4 Gc

T4 @ Ta= -20°C to +65°C
(-4°F to +149°F)
When installed per drawing 149243 or
149244.

Ordering Information



For the detailed listing of country and product-specific approvals, refer to the [Approvals Quick Reference Guide \(108M1756\)](#).

For additional technical documentation, please log in to bntechsupport.com and access the Bently Nevada Media Library.

3500/92 Communication Gateway 3500/92-AA-BB-CC

A: I/O Module Type

01	ModbusRS232/RS422 I/O Module
02	ModbusRS485 I/O Module
03	Ethernet/RS232 Modbus I/O Module
04	Ethernet/RS485 Modbus I/O Module

B: Memory Type

01	Low Memory
-----------	------------

C: Agency Approval Option

00	None
01	CSA/NRTL/C
02	CSA/ATEX/IECEX

Additional Options

Firmware

126M4118-01 Firmware Upgrade Kit



Older Communication Gateway modules will require a Firmware Upgrade to communication with a new I/O Module. See 3500/92 manual for detailed information.

Cables

Standard 10BASE-T Shielded Category 5 Cable with RJ-45 connectors

138131-AAA

A: Length (in ft.) up to 320 ft in length.

0 0 6	6 feet (1.8 meters)
0 1 0	10 feet (3 meters)
0 2 5	25 feet (7.3 meters)
0 4 0	40 feet (12 meters)
0 5 0	50 feet (15 meters)
0 7 5	75 feet (22.5 meters)
0 8 5	85 feet (25.5 meters)
1 0 0	100 feet (30.5 meters)
1 2 0	120 feet (36.6 meters)
1 5 0	150 feet (44.8 meters)
2 0 0	200 feet (61 meters)
2 5 0	250 feet (75 meters)
3 2 0	320 feet (98 meters)

Spares

Part Number	Description
04425545	Grounding Wrist Strap (single use)
137495-01	Firmware IC (Odd bank)
137494-01	Firmware IC (Even bank)
136180-01	3500/92 Communication Gateway Module.
125736-01	Modbus RS232/RS422 I/O Module.
133323-01	Modbus RS485 I/O Module.
136188-01	Ethernet/RS232 Modbus I/O Module*
136188-02	Ethernet/RS485 Modbus I/O Module*
Bently_ Manuals	International Technical Documentation DVD




* These spares include the Firmware Upgrade Kit (126M4118-01).

Accessories

Part Number	Description
139036-01	9-pin D-SUB "Y"
Serial Converters	
02230411	RS232 to RS422 Converter - 110 Vac.
02230412	RS232 to RS422 Converter - 220 Vac.
Ethernet Hubs	
165M2516	24-port 100/1000 SFP BE based switch

Part Number	Description
Ethernet Transceivers	
02200260	15-Pin AUI male to Fiber Optic Cable (10BASE-FL) with ST connection
02200261	15-Pin AUI male to Thinnet (10BASE2)
Ethernet Cabling - Standard 10 BASE-T Shielded , Category 5 Cable with RJ-45 Connectors	
02175190	6 ft. length
02175191	10 ft. length
02175192	25 ft. length

Graphs and Figures

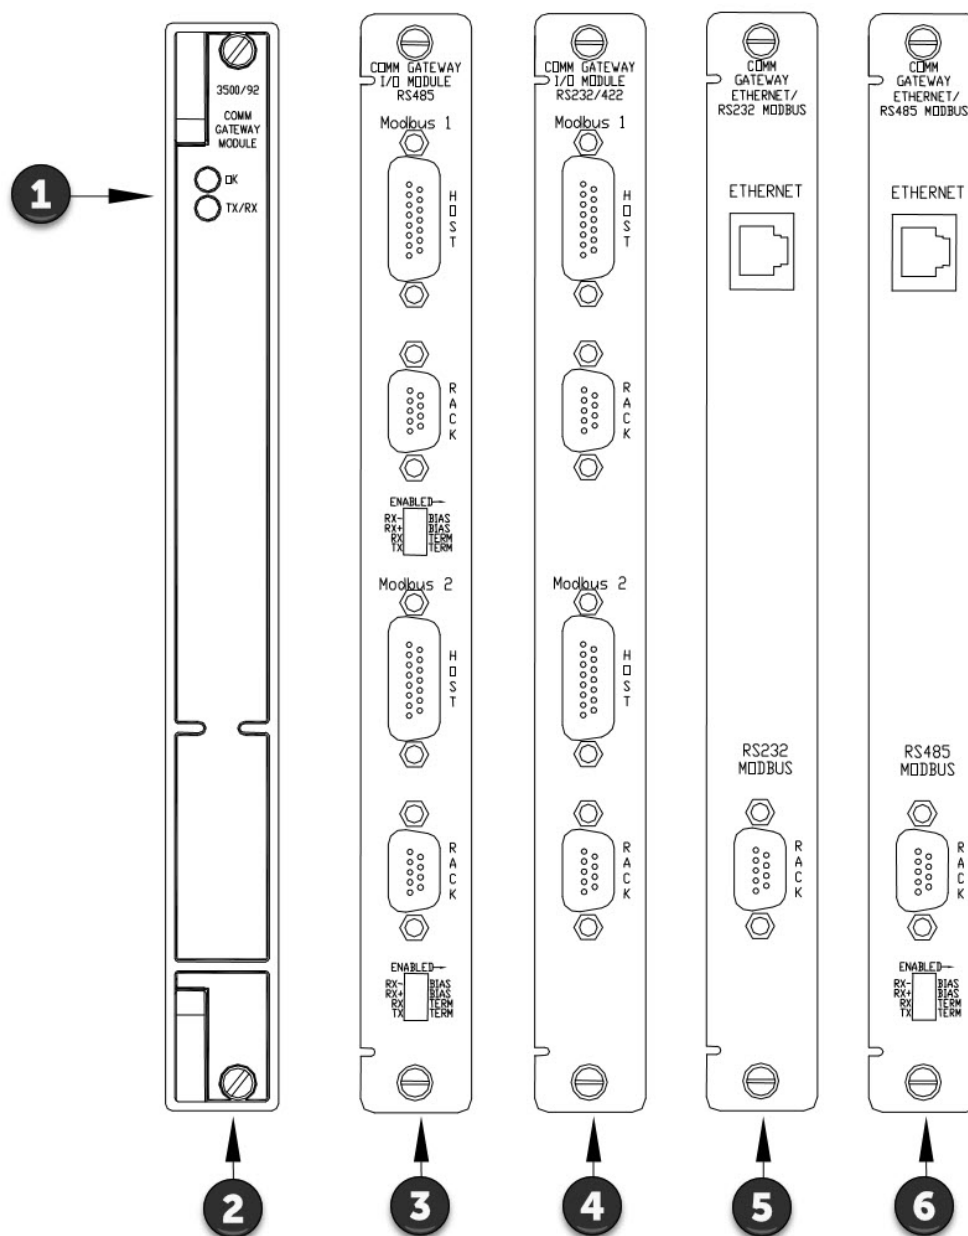

1. Status LEDs
2. Comm Gateway Module
3. RS485 I/O Module
4. RS232/422 I/O Module
5. Ethernet/RS232 I/O Module
6. Ethernet/RS485 I/O Module

Figure 1: Front and Rear Views of the 3500/92 Communication Gateway

Copyright 2024 Baker Hughes Company. All rights reserved.



Bently Nevada, M2 and Orbit Logo are registered trademarks of Bently Nevada, a Baker Hughes business, in the United States and other countries. The Baker Hughes logo is a trademark of Baker Hughes Company. All other product and company names are trademarks of their respective holders. Use of the trademarks does not imply any affiliation with or endorsement by the respective holders.

Baker Hughes provides this information on an "as is" basis for general information purposes. Baker Hughes does not make any representation as to the accuracy or completeness of the information and makes no warranties of any kind, specific, implied or oral, to the fullest extent permissible by law, including those of merchantability and fitness for a particular purpose or use. Baker Hughes hereby disclaims any and all liability for any direct, indirect, consequential or special damages, claims for lost profits, or third party claims arising from the use of the information, whether a claim is asserted in contract, tort, or otherwise. Baker Hughes reserves the right to make changes in specifications and features shown herein, or discontinue the product described at any time without notice or obligation. Contact your Baker Hughes representative for the most current information.

The information contained in this document is the property of Baker Hughes and its affiliates; and is subject to change without prior notice. It is being supplied as a service to our customers and may not be altered or its content repackaged without the express written consent of Baker Hughes. This product or associated products may be covered by one or more patents. See [Bentley.com/legal](https://www.bentley.com/legal).

1631 Bently Parkway South, Minden, Nevada USA 89423
Phone: 1.775.782.3611 (US) or [Bentley.com/support](https://www.bentley.com/support)
[Bentley.com](https://www.bentley.com)