


FIELD INSTALLATION QUICK GUIDE

Installation Instructions

330910-00-10-10-01-05

narrow sideview proximity probe

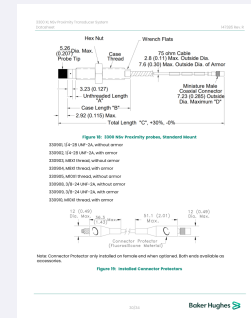

PRODUCT	330910-00-10-10-01-05
FAMILY	3300 XL NSV proximity transducer systems
FUNCTION	narrow sideview proximity probe
STATUS	Verify exact installed equipment

Prepared by Amikon Limited from 3300 XL NSV Proximity Transducer documentation. This guide supplements the complete manufacturer manual and site procedure.

01 CONFIRM THE ORDERED CONFIGURATION

Probe Thread	M10 × 1
Cable Armor	Stainless steel armor
Unthreaded Length	0 mm
Overall Case Length	100 mm
Total Cable Length	1.0 m
Connector Option	ClickLoc with protector

02 PREPARATION AND CONNECTION

- Confirm the complete 330910-00-10-10-01-05 article number and installed revision.
- Isolate applicable electrical and process energy using the approved site procedure.
- Record every connector, cable, terminal, shield and protective-earth connection before removal.
- Install without forcing keyed parts, then secure terminals, latches, fasteners and cable supports.

OFFICIAL INSTALLATION REFERENCE

3300 XL NSv Proximity Transducer System
Datasheet

147385 Rev. R

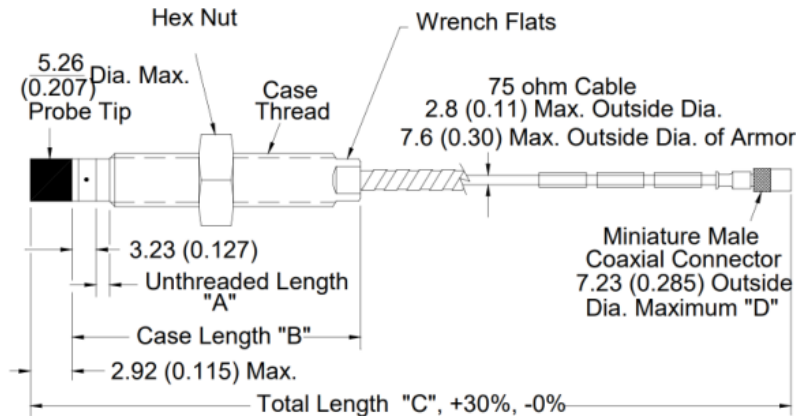


Figure 18: 3300 NSv Proximity probes, Standard Mount

330901, 1/4-28 UNF-2A, without armor

330902, 1/4-28 UNF-2A, with armor

330903, M8X1 thread, without armor


330904, M8X1 thread, with armor

330905, M10X1 thread, without armor

330908, 3/8-24 UNF-2A, without armor

330909, 3/8-24 UNF-2A, with armor

330910, M10X1 thread, with armor

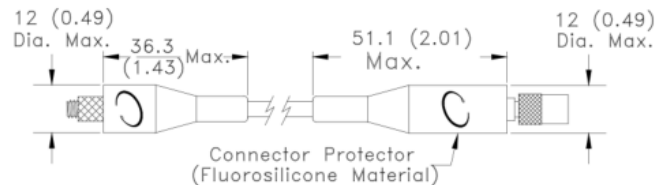

Note: Connector Protector only installed on female end when optioned. Both ends available as accessories.

Figure 19: Installed Connector Protectors

04 COMMISSIONING CHECKS

- 01 Confirm product identity and mechanical seating.
- 02 Verify the documented supply before energising.
- 03 Inspect polarity, shielding and protective-earth connections.
- 04 Restore power in the approved sequence and observe status indications.
- 05 Test each connected input, output or communication path.
- 06 Record diagnostics and functional-test results before return to service.

05 CONTROLLED DOCUMENT

Official source	Bently Nevada official manufacturer documentation
Product record	330910-00-10-10-01-05
Manufacturer	3300 XL NSV Proximity Transducer
Warranty	12 months from AMIKON
Support	INFO@AMIKON.CN

AMIKON PRODUCT SUPPORT

+86-18020776786

INFO@AMIKON.CN

AMIKONG.COM