


FIELD INSTALLATION QUICK GUIDE

Installation Instructions

1756-OF6VI

Isolated Analog Voltage Output Module

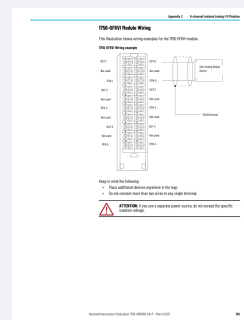

PRODUCT	1756-OF6VI
FAMILY	ControlLogix
FUNCTION	Isolated Analog Voltage Output Module
SOURCE	Rockwell 1756-UM009G and 1756-TD002M, ControlLogix Analog I/O

01 OFFICIAL MOUNTING AND WIRING

- Use the OF6VI-specific wiring diagram for each output and return terminal.
- Do not connect more than two wires to any single terminal.
- If a separate power source is used, do not exceed the specified isolation voltage.

AMIKON PRODUCT SUPPORT

+86-18020776786


INFO@AMIKON.CN

AMIKONG.COM

1756-OF6VI Module Wiring

This illustration shows wiring examples for the 1756-OF6VI module.

1756-OF6VI Wiring example

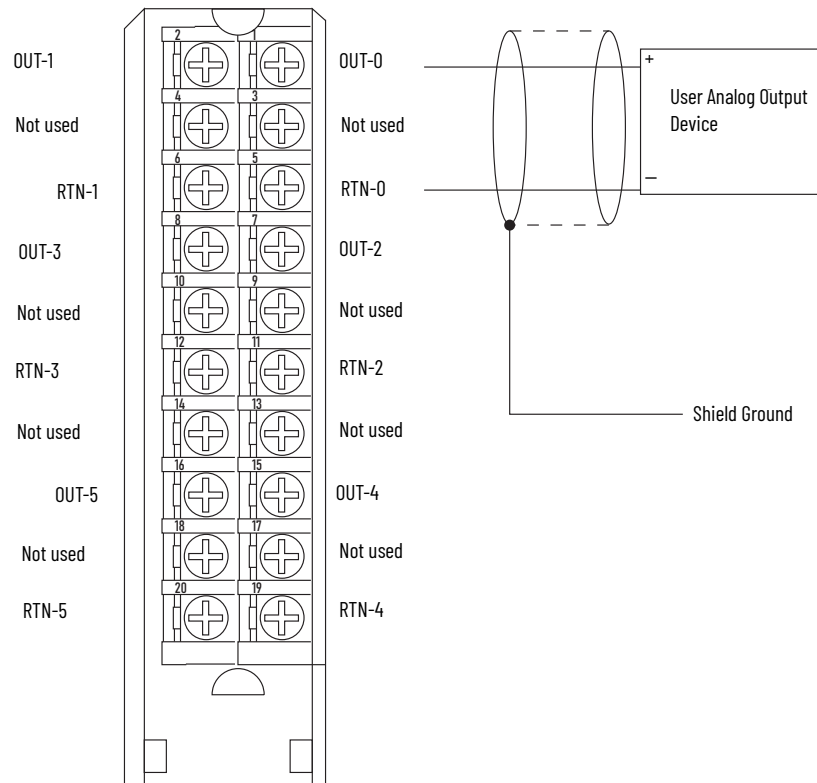

Keep in mind the following:

- Place additional devices anywhere in the loop.
- Do not connect more than two wires to any single terminal.



ATTENTION: If you use a separate power source, do not exceed the specific isolation voltage.