

MANUFACTURER DOCUMENT PACKAGE

Manufacturer's Manual

Selected official pages for procurement and maintenance review

PRODUCT BRAND

Siemens

PRODUCT MODEL

6ES7132-6BH01-0BA0

ET 200SP Standard Output Module. Relevant section pages: 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36. Adjacent model text on shared pages is outside this product reference.

OFFICIAL SOURCE

Digital output module DQ 16x24VDC/0.5A ST (6ES7132-6BH01-0BA0); 01/2025, A5E03574420-AE

Siemens original documentation and product reference

Original Siemens equipment-manual pages, edition 01/2025. The technical table starts from hardware status FS21; verify the actual unit's FS marking. Older hardware data can differ. This package does not establish safety-output suitability or unconditional replacement compatibility.

AMIKON PRODUCT SUPPORT

+86-18020776786

INFO@AMIKON.CN

AMIKONG.COM

Amikon Limited prepared this independent reference package. Selected manufacturer pages follow with their original content and pagination visible.

SIMATIC

ET 200SP

**Digital output module
DQ 16x24VDC/0.5A ST
(6ES7132-6BH01-0BA0)**

Equipment Manual

Introduction

1

Industrial cybersecurity

2

Product overview

3

Connecting

4

Parameters/address space

5

Interrupts/diagnostic alarms

6

Technical specifications

7

Parameter data record

A

Legal information

Warning notice system

This manual contains notices you have to observe in order to ensure your personal safety, as well as to prevent damage to property. The notices referring to your personal safety are highlighted in the manual by a safety alert symbol, notices referring only to property damage have no safety alert symbol. These notices shown below are graded according to the degree of danger.

DANGER

indicates that death or severe personal injury **will** result if proper precautions are not taken.

WARNING

indicates that death or severe personal injury **may** result if proper precautions are not taken.

CAUTION

indicates that minor personal injury can result if proper precautions are not taken.

NOTICE

indicates that property damage can result if proper precautions are not taken.

If more than one degree of danger is present, the warning notice representing the highest degree of danger will be used. A notice warning of injury to persons with a safety alert symbol may also include a warning relating to property damage.

Qualified Personnel

The product/system described in this documentation may be operated only by **personnel qualified** for the specific task in accordance with the relevant documentation, in particular its warning notices and safety instructions. Qualified personnel are those who, based on their training and experience, are capable of identifying risks and avoiding potential hazards when working with these products/systems.

Proper use of Siemens products

Note the following:

WARNING

Siemens products may only be used for the applications described in the catalog and in the relevant technical documentation. If products and components from other manufacturers are used, these must be recommended or approved by Siemens. Proper transport, storage, installation, assembly, commissioning, operation and maintenance are required to ensure that the products operate safely and without any problems. The permissible ambient conditions must be complied with. The information in the relevant documentation must be observed.

Trademarks

All names identified by ® are registered trademarks of Siemens Aktiengesellschaft. The remaining trademarks in this publication may be trademarks whose use by third parties for their own purposes could violate the rights of the owner.

Disclaimer of Liability

We have reviewed the contents of this publication to ensure consistency with the hardware and software described. Since variance cannot be precluded entirely, we cannot guarantee full consistency. However, the information in this publication is reviewed regularly and any necessary corrections are included in subsequent editions.

Introduction

Purpose of the documentation

This manual supplements the system manual ET 200SP distributed I/O system (<https://support.automation.siemens.com/WW/view/en/58649293>).

Functions that generally relate to the system are described in this manual.

The information provided in this manual and in the system/function manuals supports you in commissioning the system.

Conventions

CPU: When the term "CPU" is used in this manual, it applies to the CPUs of the S7-1500 automation system as well as to the CPUs/interface modules of the distributed I/O system ET 200SP.

STEP 7: In this documentation, "STEP 7" is used as a synonym for all versions of the configuration and programming software "STEP 7 (TIA Portal)".

Please also observe notes marked as follows:

NOTE

A note contains important information on the product described in the documentation, on the handling of the product or on the section of the documentation to which particular attention should be paid.

Recycling and waste disposal

For environmentally sustainable recycling and waste disposal of your old equipment, contact a certified electronic waste disposal company and dispose of the equipment according to the applicable regulations in your country.

Industrial cybersecurity

2.1 Introduction to industrial cybersecurity

Digitalization and the increasing networking of machines and industrial plants are also increasing the risk of cyberattacks. Appropriate protective measures are therefore mandatory, particularly in the case of critical infrastructure facilities.

Refer to the general information and measures on the subject of industrial cybersecurity in the ET 200SP Distributed I/O System

(<https://support.industry.siemens.com/cs/ww/en/view/58649293>) System Manual.

This section provides an overview of security-relevant information pertaining to your SIEMENS device.

2.2 Cybersecurity information

Siemens provides products and solutions with industrial cybersecurity functions that support the secure operation of plants, systems, machines and networks.

In order to protect plants, systems, machines and networks against cyber threats, it is necessary to implement – and continuously maintain – a holistic, state-of-the-art industrial cybersecurity concept. Siemens' products and solutions constitute one element of such a concept.

Customers are responsible for preventing unauthorized access to their plants, systems, machines and networks. Such systems, machines and components should only be connected to an enterprise network or the internet if and to the extent such a connection is necessary and only when appropriate security measures (e.g. firewalls and/or network segmentation) are in place.

For additional information on industrial cybersecurity measures that may be implemented, please visit

<https://www.siemens.com/cybersecurity-industry>.

Siemens' products and solutions undergo continuous development to make them more secure. Siemens strongly recommends that product updates are applied as soon as they are available and that the latest product versions are used. Use of product versions that are no longer supported, and failure to apply the latest updates may increase customer's exposure to cyber threats.

To stay informed about product updates, subscribe to the Siemens Industrial Cybersecurity RSS Feed under

<https://new.siemens.com/cert>.

Product overview

3.1 Properties

Article number

6ES7132-6BH01-0BA0 (number in package unit: 1 unit)

6ES7132-6BH01-2BA0 (number in package unit: 10 units)

View of the module

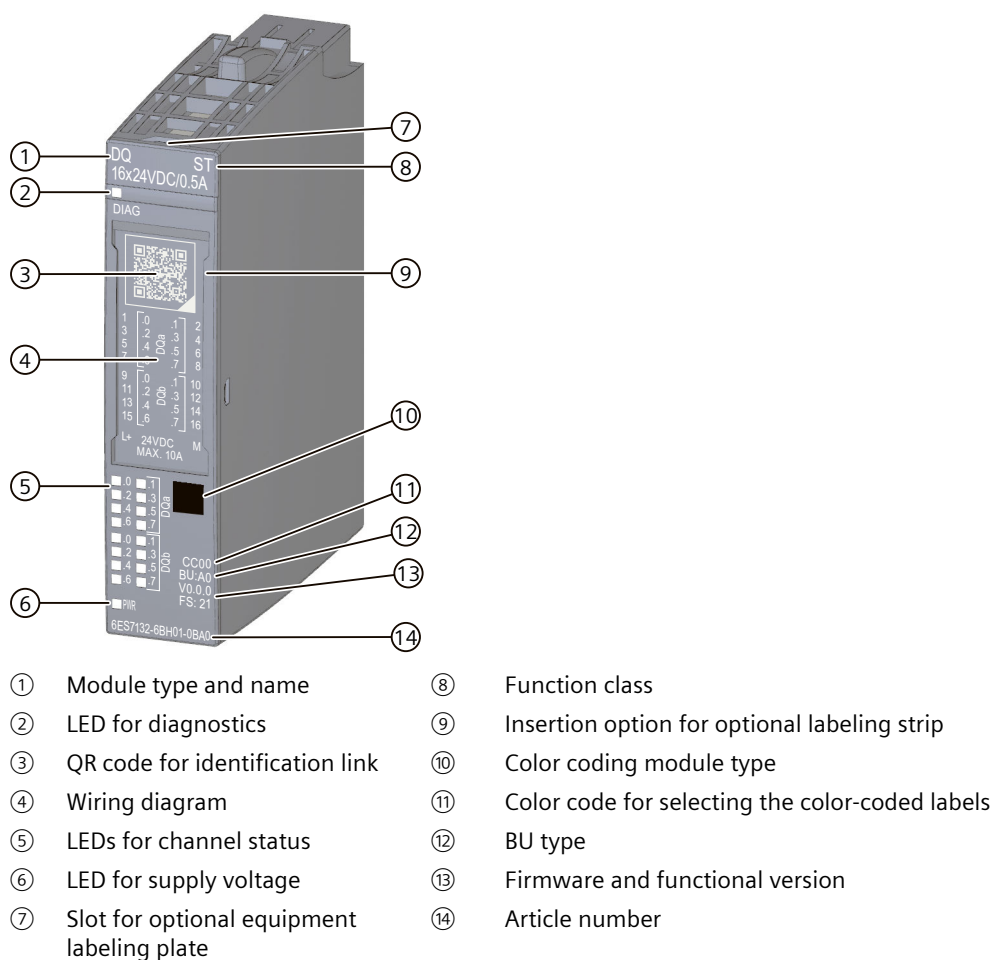


Figure 3-1 View of the module DQ 16x24VDC/0.5A ST

Properties

The module has the following technical properties:

- Digital output module with 16 outputs
- Source output (PNP, P-switching)
- Supply voltage L+
- Output current 0.5 A (per channel)
- Total current max. 8 A
(see derating: Technical specifications (Page 27))
- Configurable diagnostics (per module)
- Configurable substitute values (per channel)
- Suitable for solenoid valves, DC contactors, and indicator lights
- Extended spare parts compatibility (see product information (<https://support.industry.siemens.com/cs/ww/en/view/73021864>))

The module supports the following functions:

Table 3-1 Version dependencies of the functions

Function	HW version	FW version	STEP 7		GSD file	
			TIA Portal	V5.x	PROFINET IO	PROFIBUS DP
Identification data I&M0 to I&M3	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0230 V7.0	X	X
Reparameterizing in RUN	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0230 V7.0	X	X
PROFenergy	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0230 V7.0	X	-
Value status	FS01	V0.0.0 and higher	V14 or higher with HSP 0222	V5.5 SP3 or higher with HSP 0230 V7.0	X	X

Accessories

The following accessories are available optionally:

- Labeling strips
- Color-coded labels
- Reference identification label
- Shield connection

See also

You can find more information on accessories in the ET 200SP Distributed I/O System (<https://support.automation.siemens.com/WW/view/en/58649293>) System Manual.

Connecting

4.1 Wiring diagram

This section contains the pin assignment for the module.

You can find information on wiring the BaseUnit in the ET 200SP Distributed I/O System (<http://support.automation.siemens.com/WW/view/en/58649293>) System Manual.

NOTE

The load group of the module must begin with a light-colored BaseUnit. Also keep this in mind during configuration.

NOTICE

You may only use the digital output module with a type A0 BaseUnit.
With the type A1 BaseUnit, the integrated fuse can be triggered, rendering the terminals unusable.


NOTE

Cross-circuit at output

Note that a voltage applied at the output due to a cross-circuit can lead to the modules being supplied with L+.


Pin assignment: 1-wire connection of actuators

The following table shows an example of the pin assignment of the digital output module DQ 16x24VDC/0.5A ST on the BaseUnit BU type A0 without AUX terminals:

Description	Signal	Terminal	BaseUnit BU type A0	Terminal	Signal	Description
Digital output, channel 0	DQ ₀	1		2	DQ ₁	Digital output, channel 1
Digital output, channel 2	DQ ₂	3		4	DQ ₃	Digital output, channel 3
Digital output, channel 4	DQ ₄	5		6	DQ ₅	Digital output, channel 5
Digital output, channel 6	DQ ₆	7		8	DQ ₇	Digital output, channel 7
Digital output, channel 8	DQ ₈	9		10	DQ ₉	Digital output, channel 9
Digital output, channel 10	DQ ₁₀	11		12	DQ ₁₁	Digital output, channel 11
Digital output, channel 12	DQ ₁₂	13		14	DQ ₁₃	Digital output, channel 13
Digital output, channel 14	DQ ₁₄	15		16	DQ ₁₅	Digital output, channel 15
24 V DC supply voltage	L+	17		18	M	Ground




Pin assignment: 2-wire connection of actuators

The following table shows an example of the pin assignment of the digital output module DQ 16x24VDC/0.5A ST on the BaseUnit BU type A0 with AUX terminals:

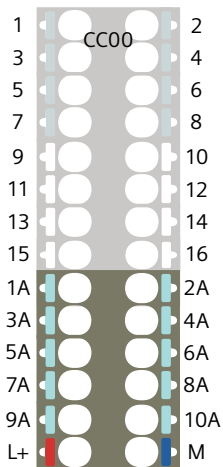Description	Signal	Terminal	BaseUnit BU type A0	Terminal	Signal	Description
Digital output, channel 0	DQ ₀	1		2	DQ ₁	Digital output, channel 1
Digital output, channel 2	DQ ₂	3		4	DQ ₃	Digital output, channel 3
Digital output, channel 4	DQ ₄	5		6	DQ ₅	Digital output, channel 5
Digital output, channel 6	DQ ₆	7		8	DQ ₇	Digital output, channel 7
Digital output, channel 8	DQ ₈	9		10	DQ ₉	Digital output, channel 9
Digital output, channel 10	DQ ₁₀	11		12	DQ ₁₁	Digital output, channel 11
Digital output, channel 12	DQ ₁₂	13		14	DQ ₁₃	Digital output, channel 13
Digital output, channel 14	DQ ₁₄	15		16	DQ ₁₅	Digital output, channel 15
AUX terminal	AUX	1A		2A	AUX	AUX terminal
AUX terminal	AUX	3A		4A	AUX	AUX terminal
AUX terminal	AUX	5A		6A	AUX	AUX terminal
AUX terminal	AUX	7A		8A	AUX	AUX terminal
AUX terminal	AUX	9A		10A	AUX	AUX terminal
24 V DC supply voltage ¹⁾	L+	L+		M	M	Ground

¹⁾ Infeed only with light BaseUnit

Output connection types

1-wire connection for channel n	2-wire connection for channel n	3-wire connection for channel n
		

You can also connect the ground and functional grounding via a potential distribution module (PotDis module) or AUX terminals. More information on potential distribution modules is available in the BaseUnits Equipment Manual (<https://support.industry.siemens.com/cs/ww/en/view/59753521>).

NOTE

You can use and combine the different connection options for all channels.

4.2 Block diagram

This section contains the schematic circuit diagram of the module.

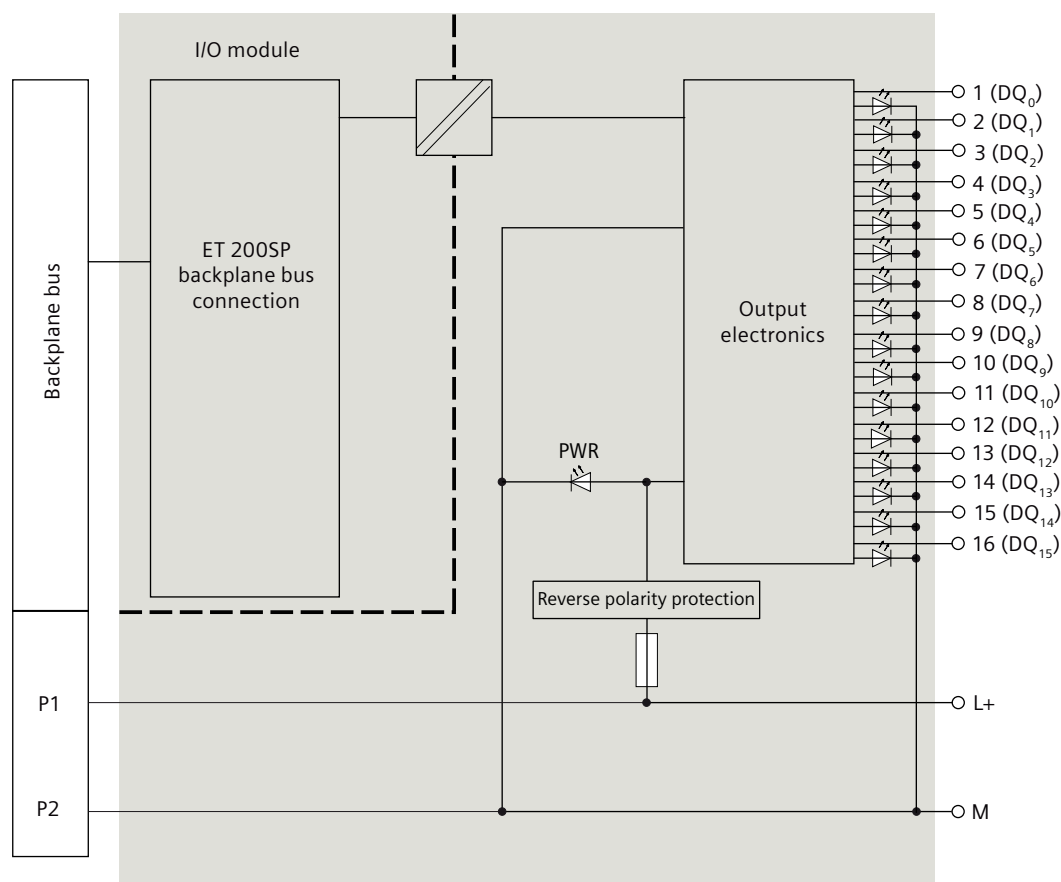


Figure 4-1 Schematic circuit diagram

Parameters/address space

5.1 Parameters

Parameters for DQ 16x24VDC/0.5A ST

You can specify the module properties with various parameters in the course of your STEP 7 configuration. The table below lists the configurable parameters. The efficiency range of the configurable parameters depends on the type of configuration.

The following configurations are possible:

- Central operation with an ET 200SP-CPU or on an ET 200SP Open Controller
- Distributed operation on PROFINET IO in an ET 200SP system
- Distributed operation with PROFIBUS DP in an ET 200SP system

In addition to parameter assignment via the configuration software, you can also configure parameters in RUN mode (dynamically) via the user program. When assigning the parameters in the user program, the "WRREC" instruction transfers the parameters to the module using data records; see section Parameter assignment and structure of parameter data record ([Page 33](#)).

The following parameter settings are possible:

Table 5-1 Configurable parameters and their defaults (GSD file)

Parameters	Range of values	Default	Parameter reassignment in RUN	Scope with configuration software, e.g. STEP 7 (TIA Portal)	
				GSD file PROFINET IO	GSD file PROFIBUS DP ¹
Diagnostics: No supply voltage L+	• Disable • Enable	Disable	Yes	Module	Module
Diagnostics: Short circuit to ground	• Disable • Enable	Disable	Yes	Module	Module
Diagnostics: Short circuit to L+	• Disable • Enable	Disable	Yes	Module	Module
Diagnostics: Wire break	• Disable • Enable	Disable	Yes	Module	Module

¹ Due to the limited number of parameters at a maximum of 244 bytes per ET 200SP station with a PROFIBUS GSD configuration, the parameter setting options are restricted. The parameter length of the I/O module is 6 bytes with PROFIBUS GSD configuration. If necessary, you can set this parameter by using the data record 128, see the appendix "Parameter data record".

Parameters	Range of values	Default	Parameter reassignment in RUN	Scope with configuration software, e.g. STEP 7 (TIA Portal)	
				GSD file PROFINET IO	GSD file PROFIBUS DP ¹
Channel activated	- Disable - Enable	Enable	Yes	Channel	Channel
Reaction to CPU STOP	- Turn off - Keep last value - Output substitute value 1	Turn off	Yes	Channel	Module
Potential group	- Use the potential group of the left module (module plugged into a dark BaseUnit) - Enable new potential group (module plugged into a light BaseUnit)	Use potential group of the left module	No	Module	Module

¹ Due to the limited number of parameters at a maximum of 244 bytes per ET 200SP station with a PROFIBUS GSD configuration, the parameter setting options are restricted. The parameter length of the I/O module is 6 bytes with PROFIBUS GSD configuration. If necessary, you can set this parameter by using the data record 128, see the appendix "Parameter data record".

NOTE

- If both parameters "Diagnostics: Short circuit to L+" and "Diagnostics: Wire break" are enabled and one of these diagnostic events occurs, the affected channel is switched off. This prevents undefined load switching and the corresponding diagnostics alarm is triggered.
- If the parameter "Diagnostics: Wire break" is enabled and the parameter "Diagnostics: Short circuit to L+" is disabled and a "Diagnostics: wire break" is pending, the affected channel is switched off. This prevents undefined load switching and the corresponding diagnostics alarm is triggered.
- If the parameter "Diagnostics: Short circuit to L+" is enabled and "Diagnostics: Wire break" is disabled, the signal status is retained at the affected channel when "Diagnostics: Short circuit to L+" occurs. A diagnostics alarm is triggered only for 0 signal.

5.2 Declaration of parameters

Diagnostics: No supply voltage L+

Enabling of the diagnostics for no or insufficient supply voltage L+.

Diagnostics: Short circuit to ground

Enabling of the diagnostics if a short circuit of the actuator supply to ground occurs.

Diagnostics: Short circuit to L+

Enabling of the diagnostics if a short circuit of the actuator supply to L+ occurs.

Diagnostics: Wire break

Enabling of the diagnostics if the line to the actuator is broken.

Channel activated

Determines whether a channel is activated or deactivated.

Reaction to CPU STOP

Determines the behavior of the module in the event of a CPU STOP.

Potential group

A potential group consists of a group of directly adjacent I/O modules within an ET 200SP station, which are supplied via a common supply voltage.

A potential group begins with a light-colored BaseUnit through which the required voltage is supplied for all modules of the potential group. The light-colored BaseUnit interrupts the three self-assembling voltage buses P1, P2, and AUX to the left neighbor.

Specify on which slot a light-colored BaseUnit with supply voltage feed or a dark BaseUnit is located (see ET 200SP Distributed I/O System

(<https://support.industry.siemens.com/cs/ww/en/view/58649293>) System Manual).

All additional I/O modules of this potential group are plugged into dark-colored BaseUnits. You take the potential of the self-assembling voltage buses P1, P2 and AUX from the left neighbor.

The station configuration must be completed with a server module.

5.3 Address space

The module can be configured differently in STEP 7; see following table. Depending on the configuration, additional/different addresses are assigned in the process image output/input.

Configuration options of DQ 16x24VDC/0.5A ST

You can configure the module with STEP 7 (TIA Portal) or with a GSD file. If you configure the module by means of a GSD file, the configurations are available under various short designations/module names; see the table below. The following configurations are possible:

Table 5-2 Configuration options with GSD file

Configuration	Short designation/module name in the GSD file	Configuration software, e.g. with STEP 7 (TIA Portal)		
		Integrated in the STEP 7 hardware catalog, as of V14 with HSP 0222	GSD file PROFINET IO	GSD file PROFIBUS DP
1 x 16-channel without value status	DQ 16x24VDC/0.5A ST V0.0	X	X	X
1 x 16-channel with value status	DQ 16x24VDC/0.5A ST V0.0, QI	X	X	X

Value status (quality information, QI)

The value status is always activated for the following configurations:

- DQ 16x24VDC/0.5A ST V0.0, QI

An additional bit is assigned to each channel for the value status. The bit for the value status indicates if the output value specified by the user program is actually pending at the module terminal (0 = value is incorrect).

You can find more information on evaluating the value status in the ET 200SP Distributed I/O System (<https://support.industry.siemens.com/cs/ww/en/view/58649293>) System Manual.

Address space for configuration as 1 x 16-channel DQ 16x24VDC/0.5A ST V0.0

The figure below shows the address space assignment for configuration as a 1 x 16-channel module without value status. You can freely assign the start address for the module. "QB" stands for output byte.

Assignment in the process image output (PIQ)

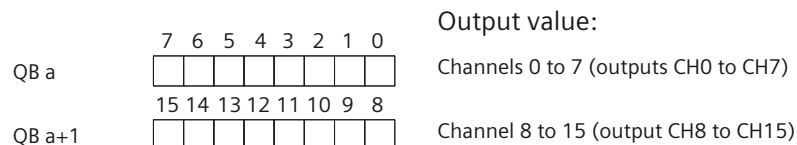


Figure 5-1 Address space for configuration as 16-channel DQ 16x24VDC/0.5A ST V0.0

5.3 Address space

Address space for configuration as 1 x 16-channel DQ 16x24VDC/0.5A ST V0.0, QI

The figure below shows the address space assignment for configuration as a 1 x 16-channel module with value status. You can freely assign the start address for the module. The addresses of the channels are derived from the start address. "IB" stands for input byte. "QB" stands for output byte.

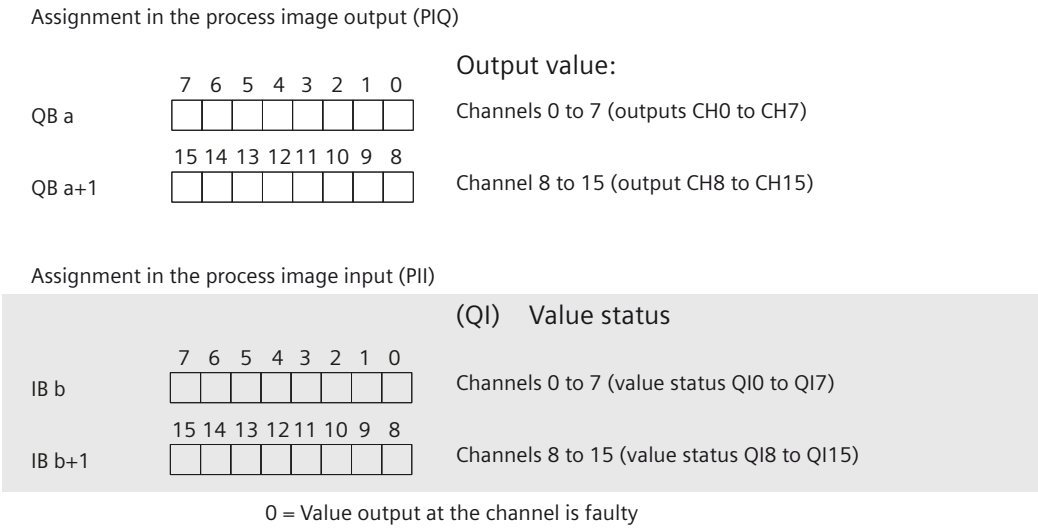


Figure 5-2 Address space for configuration as 16-channel DQ 16x24VDC/0.5A ST V0.0, QI

Interrupts/diagnostic alarms

6.1 Status and error display

LED display

The figure below shows the LED displays (status and error displays) of the module:

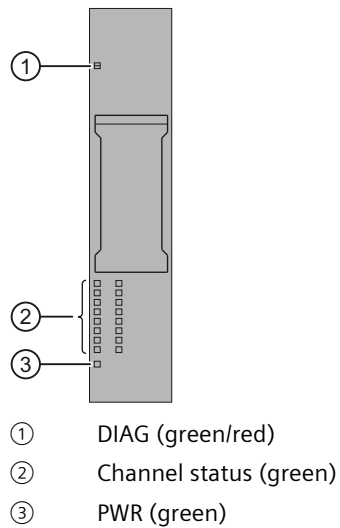


Figure 6-1 LED display

Meaning of the LEDs

The meaning of the status and error messages is described in the following tables. You will find remedial measures for diagnostics alarms in the Diagnostic messages [\(Page 26\)](#) section.

DIAG LED

Table 6-1 DIAG LED fault display

DIAG LED	Meaning
 Off	Backplane bus supply of the system is interrupted or switched off.
 Flashes	Module not configured
 On	Module parameters assigned and no module diagnostics available
 Flashes	Module parameters assigned and module diagnostics available

LED channel status

Table 6-2 LED channel status display

LED channel status	Meaning
 Off	Channel deactivated or channel activated and process signal = 0
 On	Channel activated and process signal = 1

PWR LED

Table 6-3 Status display of the PWR LED

PWR LED	Meaning
 Off	Supply voltage L+ missing
 On	Supply voltage L+ present

6.2 Interrupts

The digital output module DQ 16×24VDC/0.5A ST supports diagnostic interrupts.

Diagnostics interrupts

The module generates a diagnostic interrupt for the following events:

- Short circuit
- Wire break
- Parameter assignment error
- Supply voltage missing

You can find detailed information on events in the STEP 7 online help.

6.3 Diagnostic messages

A diagnostic message is generated and the DIAG-LED flashes red on the module for each diagnostics event. You can read out the diagnostics alarms, for example, in the diagnostics buffer of the CPU. You can evaluate the error codes with the user program.

NOTE

Wiring two outputs in parallel

When connecting two outputs in parallel for redundant control of a load, the channel diagnostics "Short circuit to L+" and "Wire break" must be disabled, otherwise faulty diagnostics alarms may occur.

Table 6-4 Diagnostics alarms, their meaning, and remedial measures

Diagnostics alarm	Error code	Meaning	Solution
Short circuit	1 _H	- Short circuit of actuator supply to ground ¹ - Short circuit of actuator supply to L+ ²	Correct the process wiring
Wire break	6 _H	Actuator circuit impedance too high	Use a different actuator type or modify the wiring, e.g. use cables with larger cross-section
		Wire break between the module and actuator	Connect the cable
		Channel not connected (open)	- Disable diagnostics - Connect a resistor to the actuator contacts in the load resistance range
Parameter assignment error	10 _H	- The module cannot evaluate parameters for the channel - Incorrect parameter assignment	Correct the parameter assignment
Supply voltage missing	11 _H	No or insufficient supply voltage L+	- Check the supply voltage L+ at the BaseUnit - Check BaseUnit type

¹ Only in switched state (output value 1)

² Only in non-switched state (output value 0)

NOTE

In case of a short circuit of the actuator supply to L+ at the activated channel, load distributions can occur which result in broken wire diagnostics.

Technical specifications

7.1 Technical specifications

Technical specifications of the DQ 16x24VDC/0.5A ST

The following table lists the technical specifications on the issue date. You will find a data sheet including daily updated technical specifications on the Internet

(<https://support.industry.siemens.com/cs/ww/en/pv/6ES7132-6BH01-0BA0/td?dl=en>).

Article number	6ES7132-6BH01-0BA0
General information	
Product type designation	DQ 16x24VDC/0.5 ST
HW functional status	from FS21
Firmware version	V0.0
FW update possible	No
usable BaseUnits	BU type A0
Color code for module-specific color identification plate	CC00
Product function	
I&M data	Yes; I&M0 to I&M3
Isochronous mode	No
Engineering with	
STEP 7 TIA Portal configurable/integrated from version	STEP 7 TIA V14 with HSP0222 / integrated as of TIA V15
STEP 7 configurable/integrated from version	V5.5 SP3 with HSP0230 V7.0 / integrated as of V5.6 SP1
PCS 7 configurable/integrated from version	V8.1 SP1
PROFIBUS from GSD version/GSD revision	One GSD file each, Revision 3 and 5 and higher
PROFINET from GSD version/GSD revision	GSDML V2.3
Operating mode	
DQ	Yes
DQ with energy-saving function	No
PWM	No
Oversampling	No
MSO	No

7.1 Technical specifications

Article number	6ES7132-6BH01-0BA0
Supply voltage	
Rated value (DC)	24 V
permissible range, lower limit (DC)	19.2 V
permissible range, upper limit (DC)	28.8 V
Reverse polarity protection	Yes
Input current	
Current consumption, max.	30 mA; without load
output voltage / header	
Rated value (DC)	24 V
Power loss	
Power loss, typ.	1 W
Address area	
Address space per module	
• Address space per module, max.	2 byte; + 2 bytes for QI information
Hardware configuration	
Automatic encoding	Yes
• Mechanical coding element	Yes
• Type of mechanical coding element	Type A
Selection of BaseUnit for connection variants	
• 1-wire connection	BU type A0
• 2-wire connection	BU type A0 with AUX terminals or potential distributor module
• 3-wire connection	BU type A0 with AUX terminals or potential distributor module
Digital outputs	
Type of digital output	Source output (PNP, current-sourcing)
Number of digital outputs	16
Current-sinking	No
Current-sourcing	Yes
Digital outputs, parameterizable	Yes
output characteristic acc. to IEC 61131, type 0.5	Yes
Short-circuit protection	Yes; Electronic
• Response threshold, typ.	1 A; 0.7 to 1.3 A
Open-circuit detection	Yes
Limitation of inductive shutdown voltage to	Typ. L+ (-50 V)
Controlling a digital input	Yes
Switching capacity of the outputs	
• with resistive load, max.	0.5 A
• with inductive load, max.	0.5 A
• on lamp load, max.	5 W

Article number	6ES7132-6BH01-0BA0
Load resistance range - lower limit - upper limit	48 Ω 12 kΩ
Output current - for signal "1" rated value - for signal "1" permissible range, max. - for signal "0" residual current, max.	0.5 A 0.5 A 0.1 mA
Output delay with resistive load "0" to "1", typ. "1" to "0", typ.	50 μs 100 μs
Parallel switching of two outputs - for uprating - for redundant control of a load	No Yes
Switching frequency - with resistive load, max. - with inductive load, max. - on lamp load, max.	100 Hz 0.1 Hz; higher frequencies are possible, see Equipment Manual "Maximum permitted switching frequency of inductive loads" 10 Hz
Total current of the outputs - Current per channel, max. - Current per module, max.	0.5 A 8 A; see Equipment Manual "Derating curve"
Total current of the outputs (per module)	
horizontal installation - up to 40 °C, max. - up to 50 °C, max. - up to 60 °C, max.	8 A 6 A 4 A
vertical installation - up to 30 °C, max. - up to 40 °C, max. - up to 50 °C, max.	8 A 6 A 4 A
Cable length - shielded, max. - unshielded, max.	1 000 m 600 m
Interrupts/diagnostics/status information	
Diagnostics function	Yes
Substitute values connectable	Yes
Alarms Diagnostic alarm	Yes

Article number	6ES7132-6BH01-0BA0
Diagnoses	
• Monitoring the supply voltage	Yes
• Wire-break	Yes; Module-wise
• Short-circuit to M	Yes; Module-wise
• Short-circuit to L+	Yes; Module-wise
• Group error	Yes
Diagnostics indication LED	
• Monitoring of the supply voltage (PWR-LED)	Yes; green PWR LED
• Channel status display	Yes; green LED
• for channel diagnostics	No
• for module diagnostics	Yes; green/red DIAG LED
Potential separation	
Potential separation channels	
• between the channels	No
• between the channels and backplane bus	Yes
• Between the channels and load voltage L+	No
Isolation	
Isolation tested with	707 V DC (type test)
Standards, approvals, certificates	
Suitable for safety functions	No
Suitable for safety-related tripping of standard modules	No
Ambient conditions	
Ambient temperature during operation	
• horizontal installation, min.	-30 °C; < 0 °C as of FS03
• horizontal installation, max.	60 °C
• vertical installation, min.	-30 °C; < 0 °C as of FS03
• vertical installation, max.	50 °C
Altitude during operation relating to sea level	
• Installation altitude above sea level, max.	5 000 m; restrictions for installation altitudes > 2 000 m, see ET 200SP system manual
Dimensions	
Width	15 mm
Height	73 mm
Depth	58 mm
Weights	
Weight, approx.	30 g

Residual current for signal state "0"

NOTE

Residual current for signal state "0"

Due to the "Diagnostics: Wire break" function, there is a low level of residual current in the "0" signal state at the output, which may cause the display diodes to flicker.

This residual current does not depend on the setting for the "Diagnostics: Wire break" parameter.

Derating trend

The figure below shows the load current derating with horizontal and vertical mounting positions. You use this diagram to determine the maximum total current of the module as a function of ambient temperature.

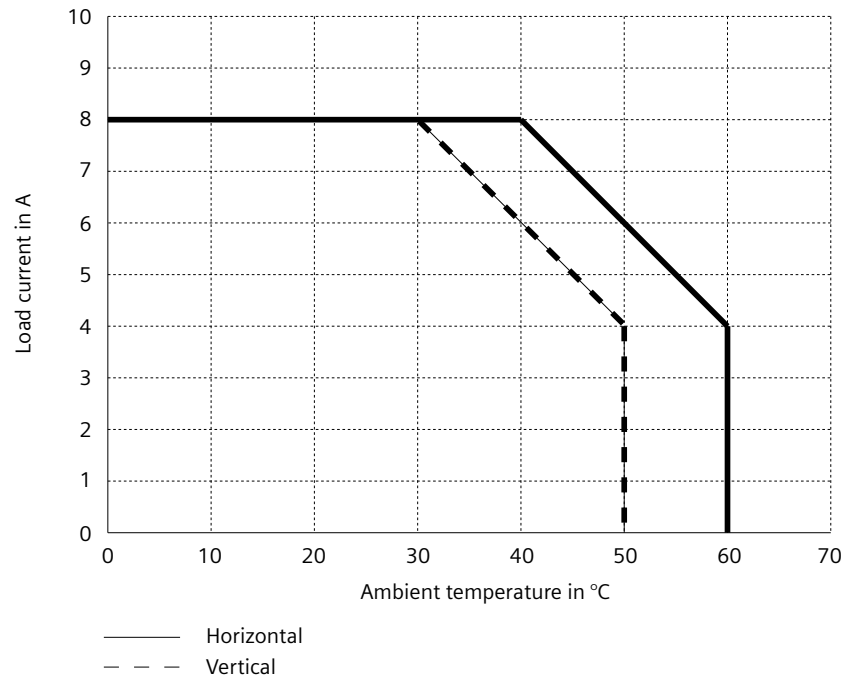


Figure 7-1 Load current vs. ambient temperature in different mounting positions

If one channel drives a cyclically switched inductive load, this channel contributes 500 mA to the total current.

Parameter data record

A.1 Parameter assignment and structure of parameter data record

The data record of the module has an identical structure, regardless of whether you configure the module with PROFIBUS DP or PROFINET IO. With data record 128, you can reparameterize the module in your user program, regardless of your programming. This means that you can use all the functions of the module even if you configured it via PROFIBUS-GSD.

Parameter assignment in the user program

You can reassign the parameters of the module in RUN. For example, the reaction to CPU STOP of individual channels can be changed in RUN without this having an effect on the other channels.

Changing parameters in RUN

The "WRREC" instruction is used to transfer the parameters to the module using data record 128. The parameters set with STEP 7 are not changed on the CPU, which means that the parameters set in STEP 7 are valid again after a restart.

If you reconfigure a module and diagnostics are pending prior to the reconfiguration, these diagnostics are not signaled as "outgoing".

Output parameter STATUS

If errors occur when transferring parameters with the "WRREC" instruction, the module continues operation with the previous parameter assignment. The STATUS output parameter contains a corresponding error code.

You will find a description of the "WRREC" instruction and the error codes in the STEP 7 online help.

Structure of data record 128

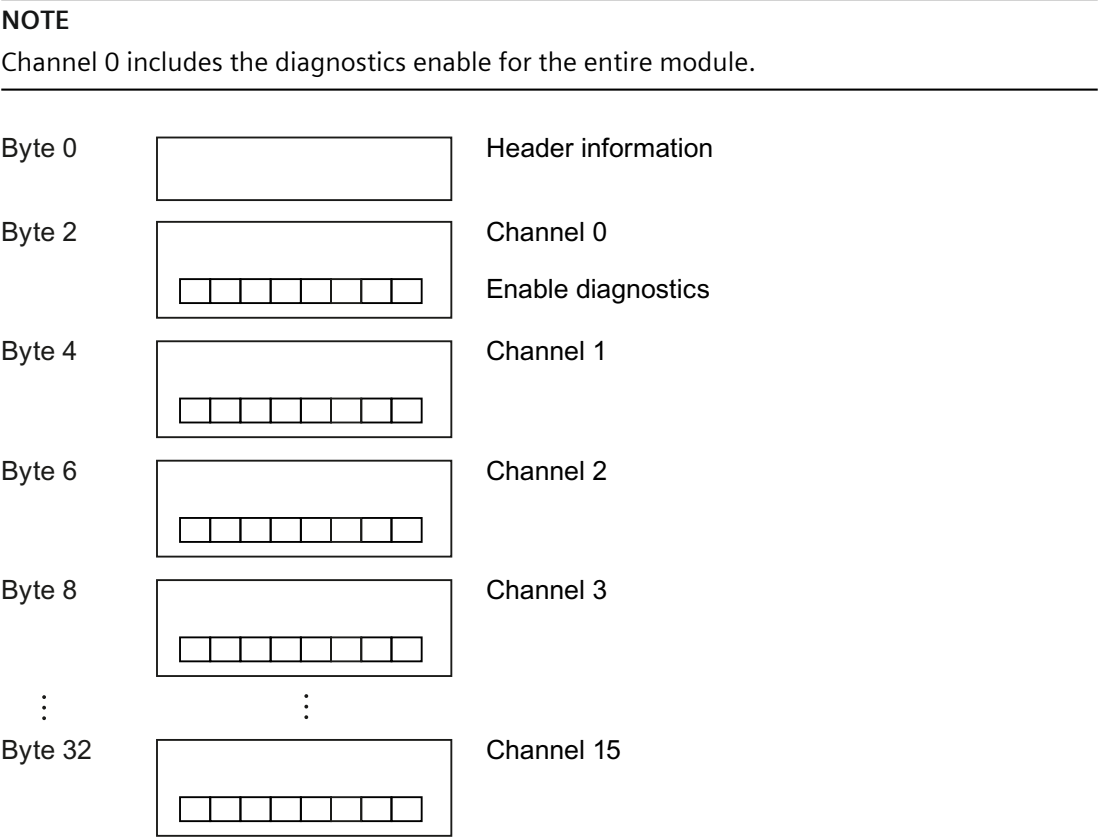


Figure A-1 Structure of data record 128

Header information

The figure below shows the structure of the header information.


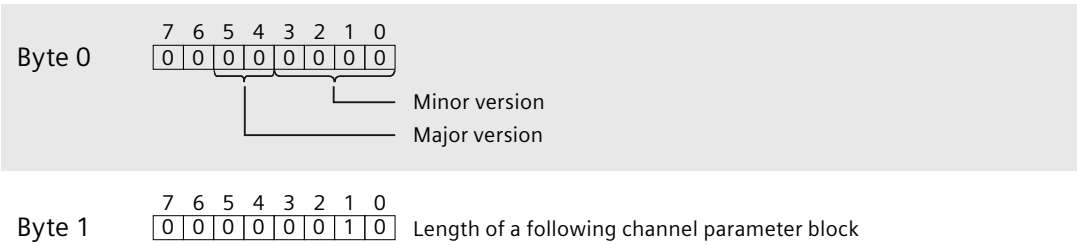


Figure A-2 Header information

Parameters

The figure below shows the structure of the parameters for channels 0 to 15.

You enable a parameter by setting the corresponding bit to "1".

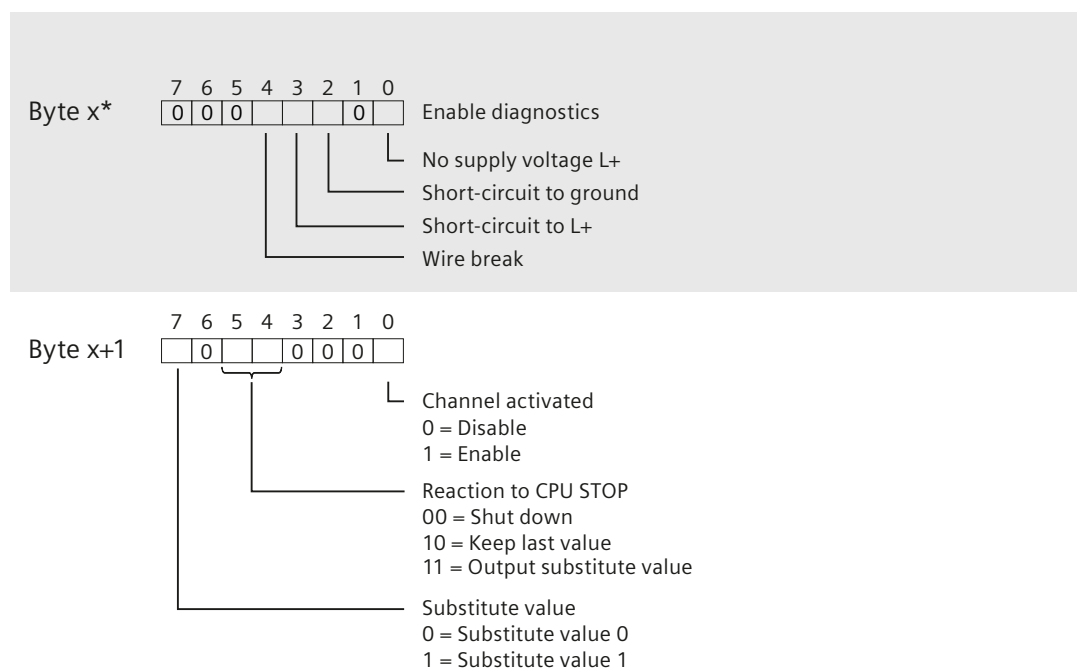

* $x = 2 + (\text{channel number} \times 2)$; channel number = 0 to 15

Figure A-3 Structure byte x to x+1 for the channels 0 to 15

A.2 Error codes

Error transferring the data record

The module always checks all the values of the transferred data record. Only if all the values were transferred without errors does the module apply the values from the data record.

The WRREC instruction for writing data records returns corresponding error codes when errors occur in the STATUS parameter.

The table below shows the module-specific error codes and their meaning for parameter data record 128.

Table A-1 Error messages, their meaning, and remedial measures

Error code in STATUS parameter (hexadecimal)				Meaning	Solution
Byte 0	Byte 1	Byte 2	Byte 3		
DF _H	80 _H	B0 _H	00 _H	Number of the data record unknown	Enter a valid number for the data record.
DF _H	80 _H	B1 _H	02 _H	Length of the data record incorrect	Enter a valid value for the data record length.

A.2 Error codes

Error code in STATUS parameter (hexadecimal)				Meaning	Solution
Byte 0	Byte 1	Byte 2	Byte 3		
DF _H	80 _H	B2 _H	00 _H	Module not accessible	- Check station. - Plug the module in correctly. - Check parameters of the WRREC block.
DF _H	80 _H	E0 _H	01 _H	Header error (version or specified bits incorrect).	Correct version number or fixed bits, see Header information (Page 34).
DF _H	80 _H	E0 _H	02 _H	Header error (number or length of parameter structures or parameter blocks incorrect)	Correct the number and length of the parameter structures or parameter blocks, see Header information (Page 34).
DF _H	80 _H	E1 _H	01 _H	Reserved bit set	Write 0 to all reserved bits.
DF _H	80 _H	E1 _H	06 _H	Invalid coding for substitute value behavior.	Use valid code for "Reaction to CPU STOP" parameter, see Structure byte x to x+1 for the channels 0 to 15 (Page 34-35).